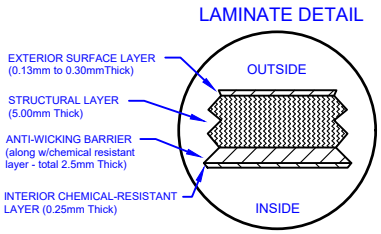

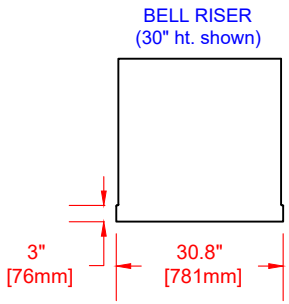

SECTION-JOINT DETAIL

Specifications				
Cylinder Thickness	0.300"		Liquid Depth (holding tank)	N/A
End Cap Thickness	0.300"		Septic Chamber Depth	49"
Inlet Height (C.L.)	56"		Effluent Chamber Depth	49"
Outlet Height (C.L.)	30"		Chamber Wall dimensions	
Inlet Diameter	4"		Height:	60"
Outlet Diameter (Not installed)	2"		Thickness:	0.66"
Rib Dimension (C to C)	16.5"		Opening Diameter:	4"

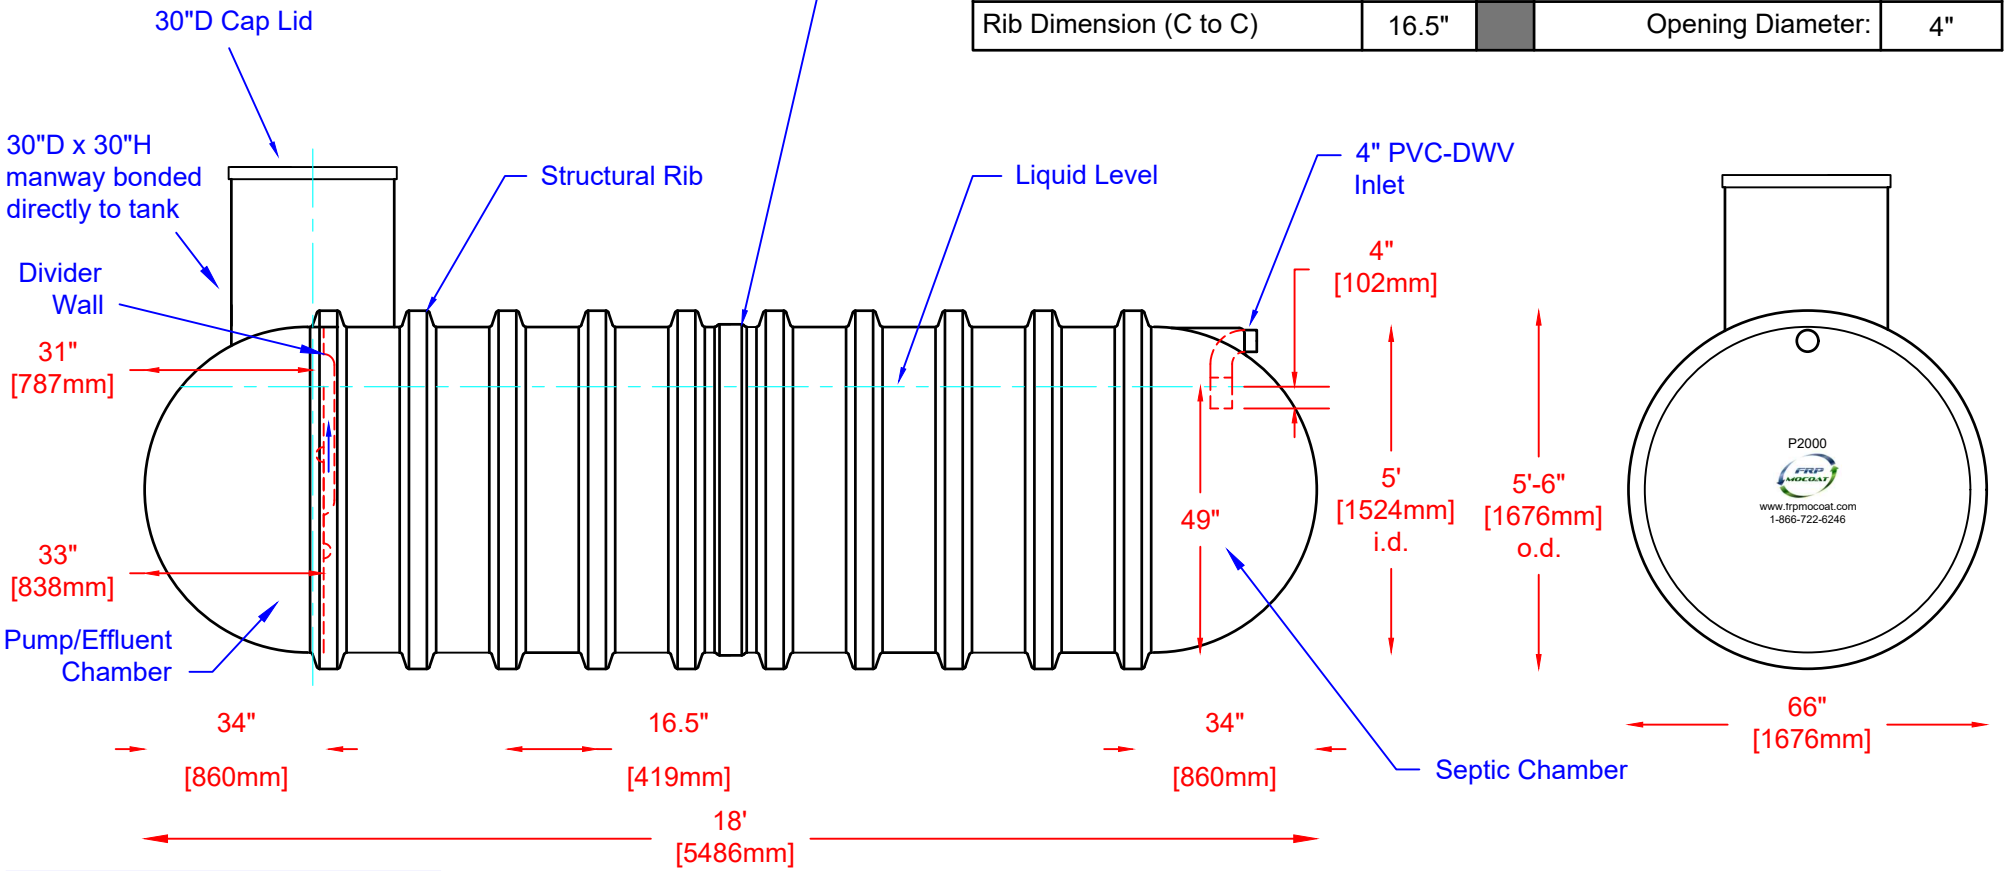

	P2000-BONDED FIBREGLASS PUMPOUT TANK	DATE: 02-14-2022
	Overall Length: Approx. 5,486mm (18')	BY: MPS
	Overall Weight: Approx. 510 kg (1,125 lbs)	BURIAL DEPTH: 7 Ft
	Septic Chamber: Approx. 7,045L (1,550 Imp Gal, 1,860 US Gal)	REV: 1
	Effluent Chamber: Approx. 963L (212 Imp Gal, 254 US Gal)	APPROVAL:
	Overall Capacity: Approx. 9,090L (2,000 Imp Gal, 2,400 US Gal)	DATE:

Website: www.frpmocoat.com
Toll Free: 1-866-722-6246