

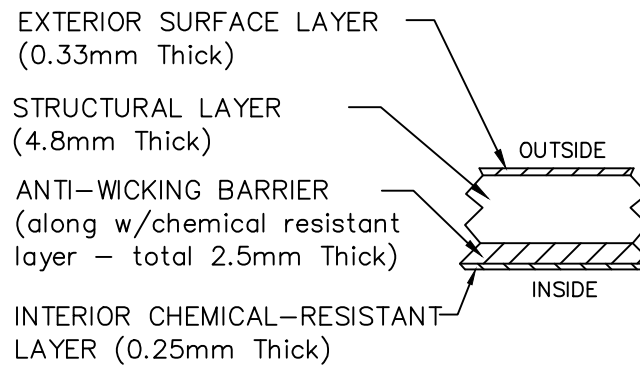
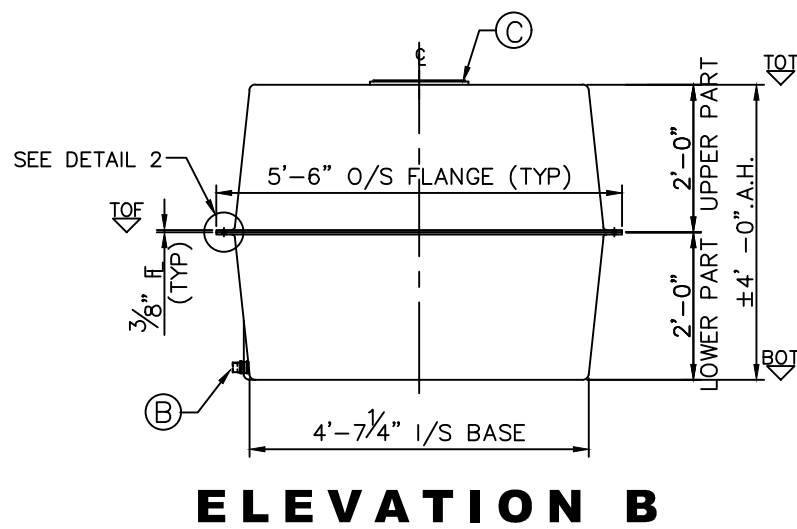
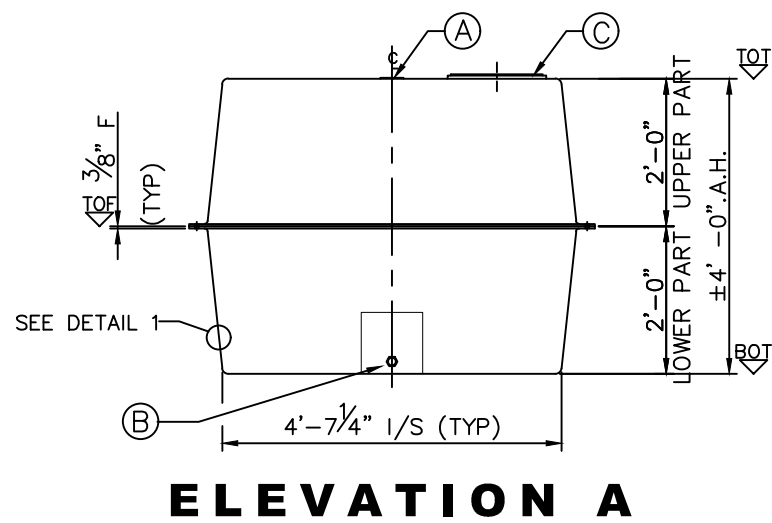


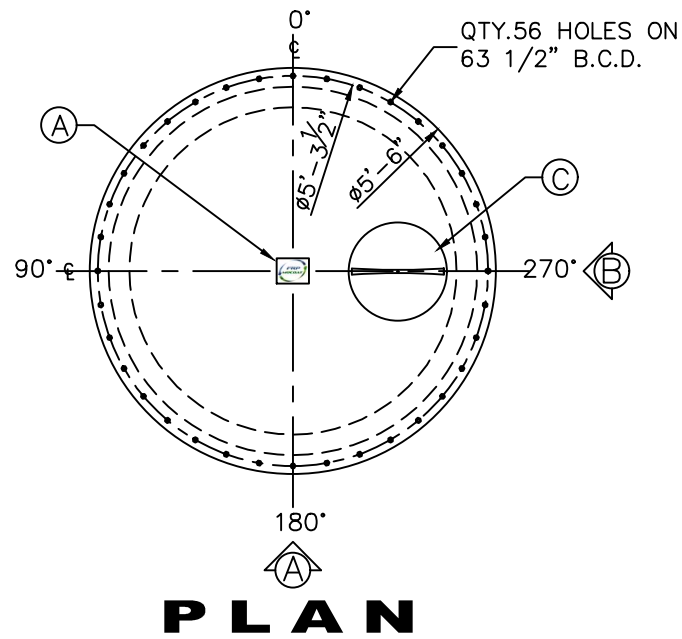

LAMINATE DETAIL 1
N T S

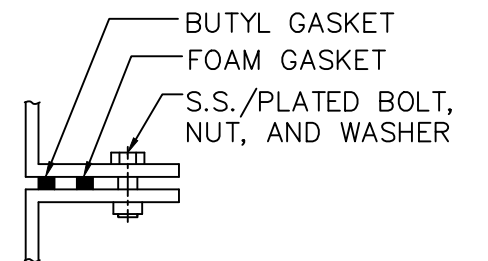

FLANGE TO FLANGE CONNECTION DETAIL 2
N T S

LEGEND:
 TOL – TOP OF LID
 TOF – TOP OF FLANGE
 BCD – BOLT CENTER DIAMETER
 TOP – TOP CYLINDER
 BOT – BOTTOM CYLINDER
 O.A.H.–OVERALL HEIGHT
 O.A.L.–OVERALL LENGTH
 I/S – INSIDE
 O/S – OUTSIDE
 Ø – DIAMETER
 ° – DEGREE/S
 TYP– TYPICAL
 CL – CENTER LINE
 NTS – NOT TO SCALE

GENERAL NOTES	
- CSA ANSI/NSF 61 CERTIFIED FRP POTABLE WATER TANK. - TANK COMES UNASSEMBLED FROM FACTORY. - ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN. - DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED. - 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.	

ITEM#	QTY	PART LIST	DESCRIPTION
A	1	NAMEPLATE	
B	1	1 1/4" BULK HEAD	OUTLET
C	1	16" Ø VENTED POLY LID	FRP LID
D			
E			
F			
G			

WEIGHT:		DRAWN:	EA/ATF
WORKING CAPACITY:	N/A	CHECKED:	MPS
OVERALL CAPACITY:	2,273 L (500 IG/600 USG)	DATE:	AUG. 20,2025
		DESIGNED:	FRP
		APPROVED:	MPS
		MFG.:	DS
		QA:	GA
		SALES:	TA



CLIENT: FRP/MOCOAT FIBERGLASS LTD.		TITLE: AGW500- RD FRP POTABLE WATER TANK	
SIZE: B		DRAWING NUMBER: AGW500- RD	
SCALE: 1:30		REVISION: 0	
EST#:		SHEET: 1/1	
PO#:			