




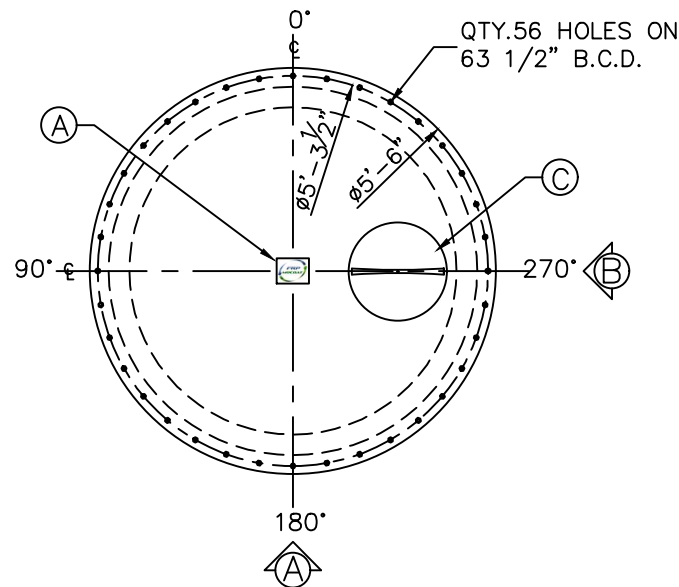


PLAN

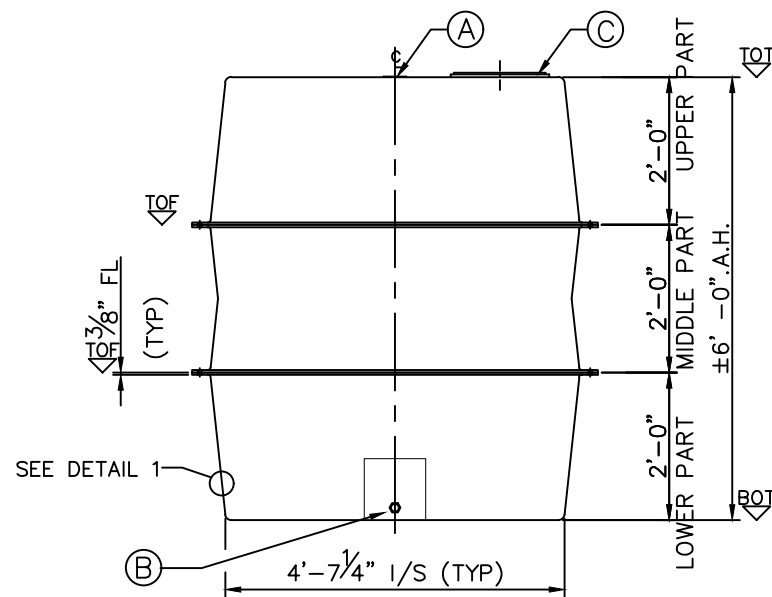


ELEVATION A

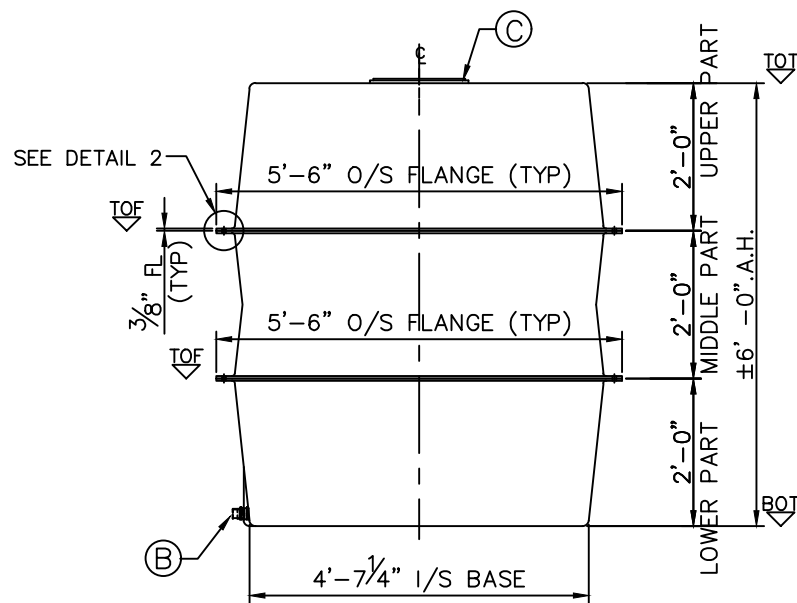

ELEVATION B

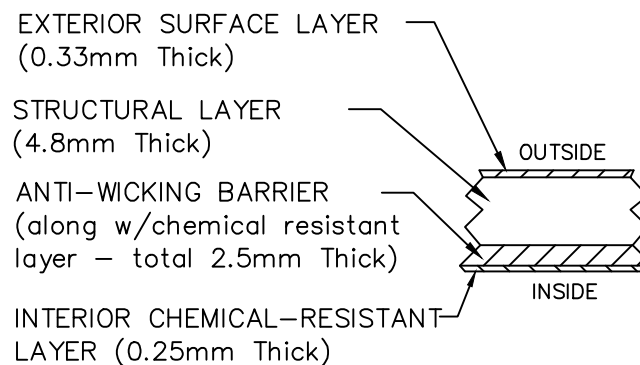

LAMINATE DETAIL 1
N T S

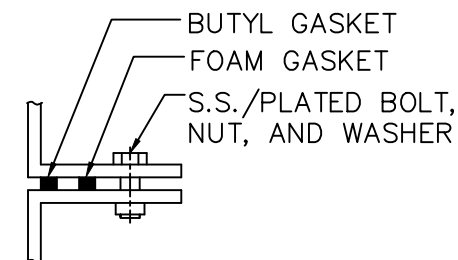

FLANGE TO FLANGE CONNECTION DETAIL 2
N T S

LEGEND:
TOL – TOP OF LID
TOF – TOP OF FLANGE
BCD – BOLT CENTER DIAMETER
TOP – TOP CYLINDER
BOT – BOTTOM CYLINDER
O.A.H.–OVERALL HEIGHT
O.A.L.–OVERALL LENGTH
I/S – INSIDE
O/S – OUTSIDE
∅ – DIAMETER
° – DEGREE/S
TYP– TYPICAL
℄ – CENTER LINE
NTS – NOT TO SCALE

GENERAL NOTES	
- CSA ANSI/NSF 61 CERTIFIED FRP POTABLE WATER TANK. - TANK COMES UNASSEMBLED FROM FACTORY. - ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN. - DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED. - 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.	

ITEM#	QTY	PART LIST	DESCRIPTION
A	1	NAMEPLATE	
B	1	1 1/4" BULK HEAD	OUTLET
C	1	16" Ø VENTED POLY LID	FRP LID
D			
E			
F			
G			

WEIGHT:	136KG (300LBS.)	DRAWN:	EA/ATF
WORKING CAPACITY:	N/A	CHECKED:	MPS
OVERALL CAPACITY:	3,410 L (750 IG/900 USG)	DATE:	AUG. 20,2025
		DESIGNED:	FRP
		APPROVED:	MPS
		MFG.:	DS
		QA:	GA
		SALES:	TA



CLIENT:		FRP/MOCOAT FIBERGLASS LTD.	
TITLE:		AGW750- RD FRP POTABLE WATER TANK	
		FRPMOCOAT FIBERGLASS LTD.	
SIZE:	DRAWING NUMBER:	REVISION:	
B	AGW750- RD	0	
SCALE:	EST#:	SO#:	SHEET:
1:30	PO#:	JOB#:	1/1