


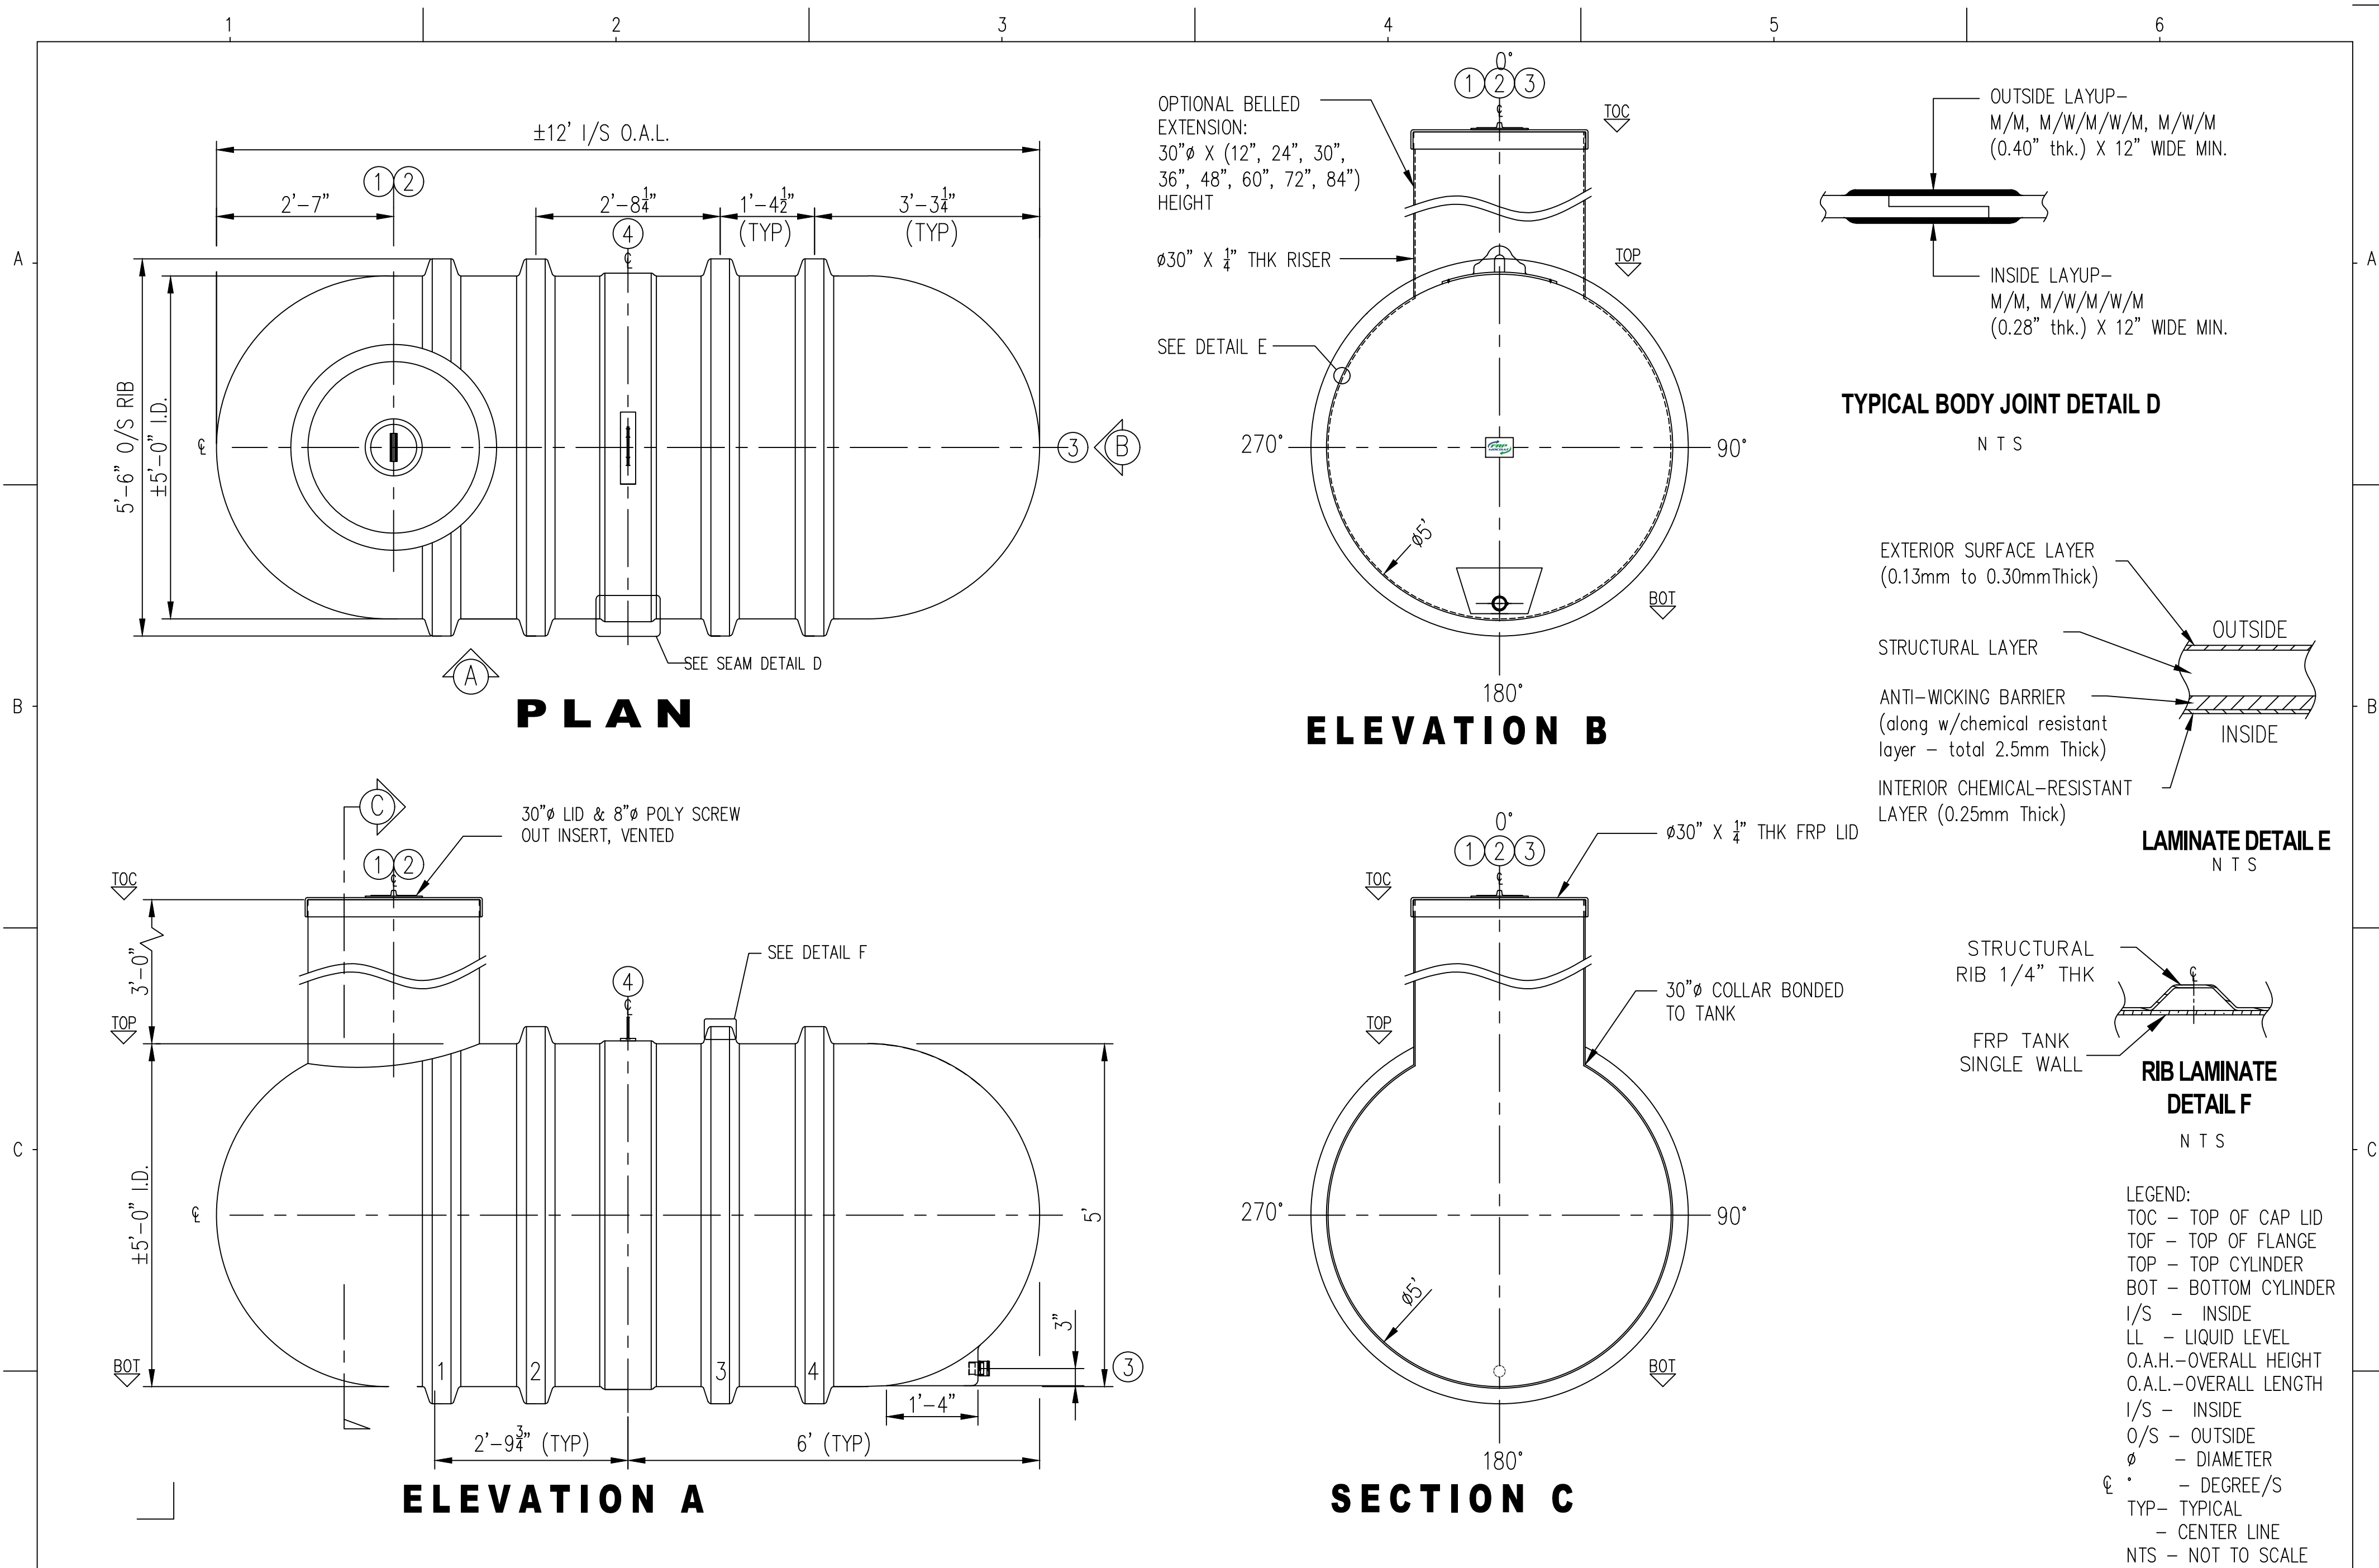

GENERAL NOTES		ITEM#		QTY	PART LIST	DESCRIPTION	SHELL THICKNESS: 0.300"		DRAWN:		CLIENT: FRP/MOCOAT FIBERGLASS LTD.		
- CSA ANSI/NSF 61 CERTIFIED FRP POTABLE WATER TANK. - RATED FOR 7' OF BURIAL DEPTH AND NO TRAFFIC LOADING. - ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN.. - DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED. - 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.		1	1	30"CAP LID W/ 8"D POLY SCREW OUT INSERT, VENTED	FRP LID	DISH HEAD THICKNESS: 0.300"		CHECKED:	TITLE: W1250 FRP POTABLE WATER TANK				
		2	1	30" MANWAY COLLAR	30"Ø FRP MANWAY	RIBS THICKNESS: 0.25" WITH 1 WR		DATE:	AUG. 12,2025		 FRP MOCOAT		
		3	1	2" BULK HEAD	INLET	RIB SPACING: 16-1/2" CL TO CL		DESIGNED:			FIBERGLASS LTD.		
		4	1	GALVANIZED STEEL WIRE ROPE	LIFT LUG	WEIGHT: 283KG (550LBS)		APPROVED:	MPS		SIZE: C	DRAWING NUMBER: W1250	REVISION: 0
		5				LENGTH: 3,658MM (10'-0")		MFG.:	DS				
		6				OVERALL CAPACITY: 5,682L (1,250 IG/1,500 USG)		QA:	GA		SCALE: 1:20	WEIGHT:	SHEET: 1/1
		7					SALES:	TA	BURIAL DEPTH:	RATED 7'- 0"			