



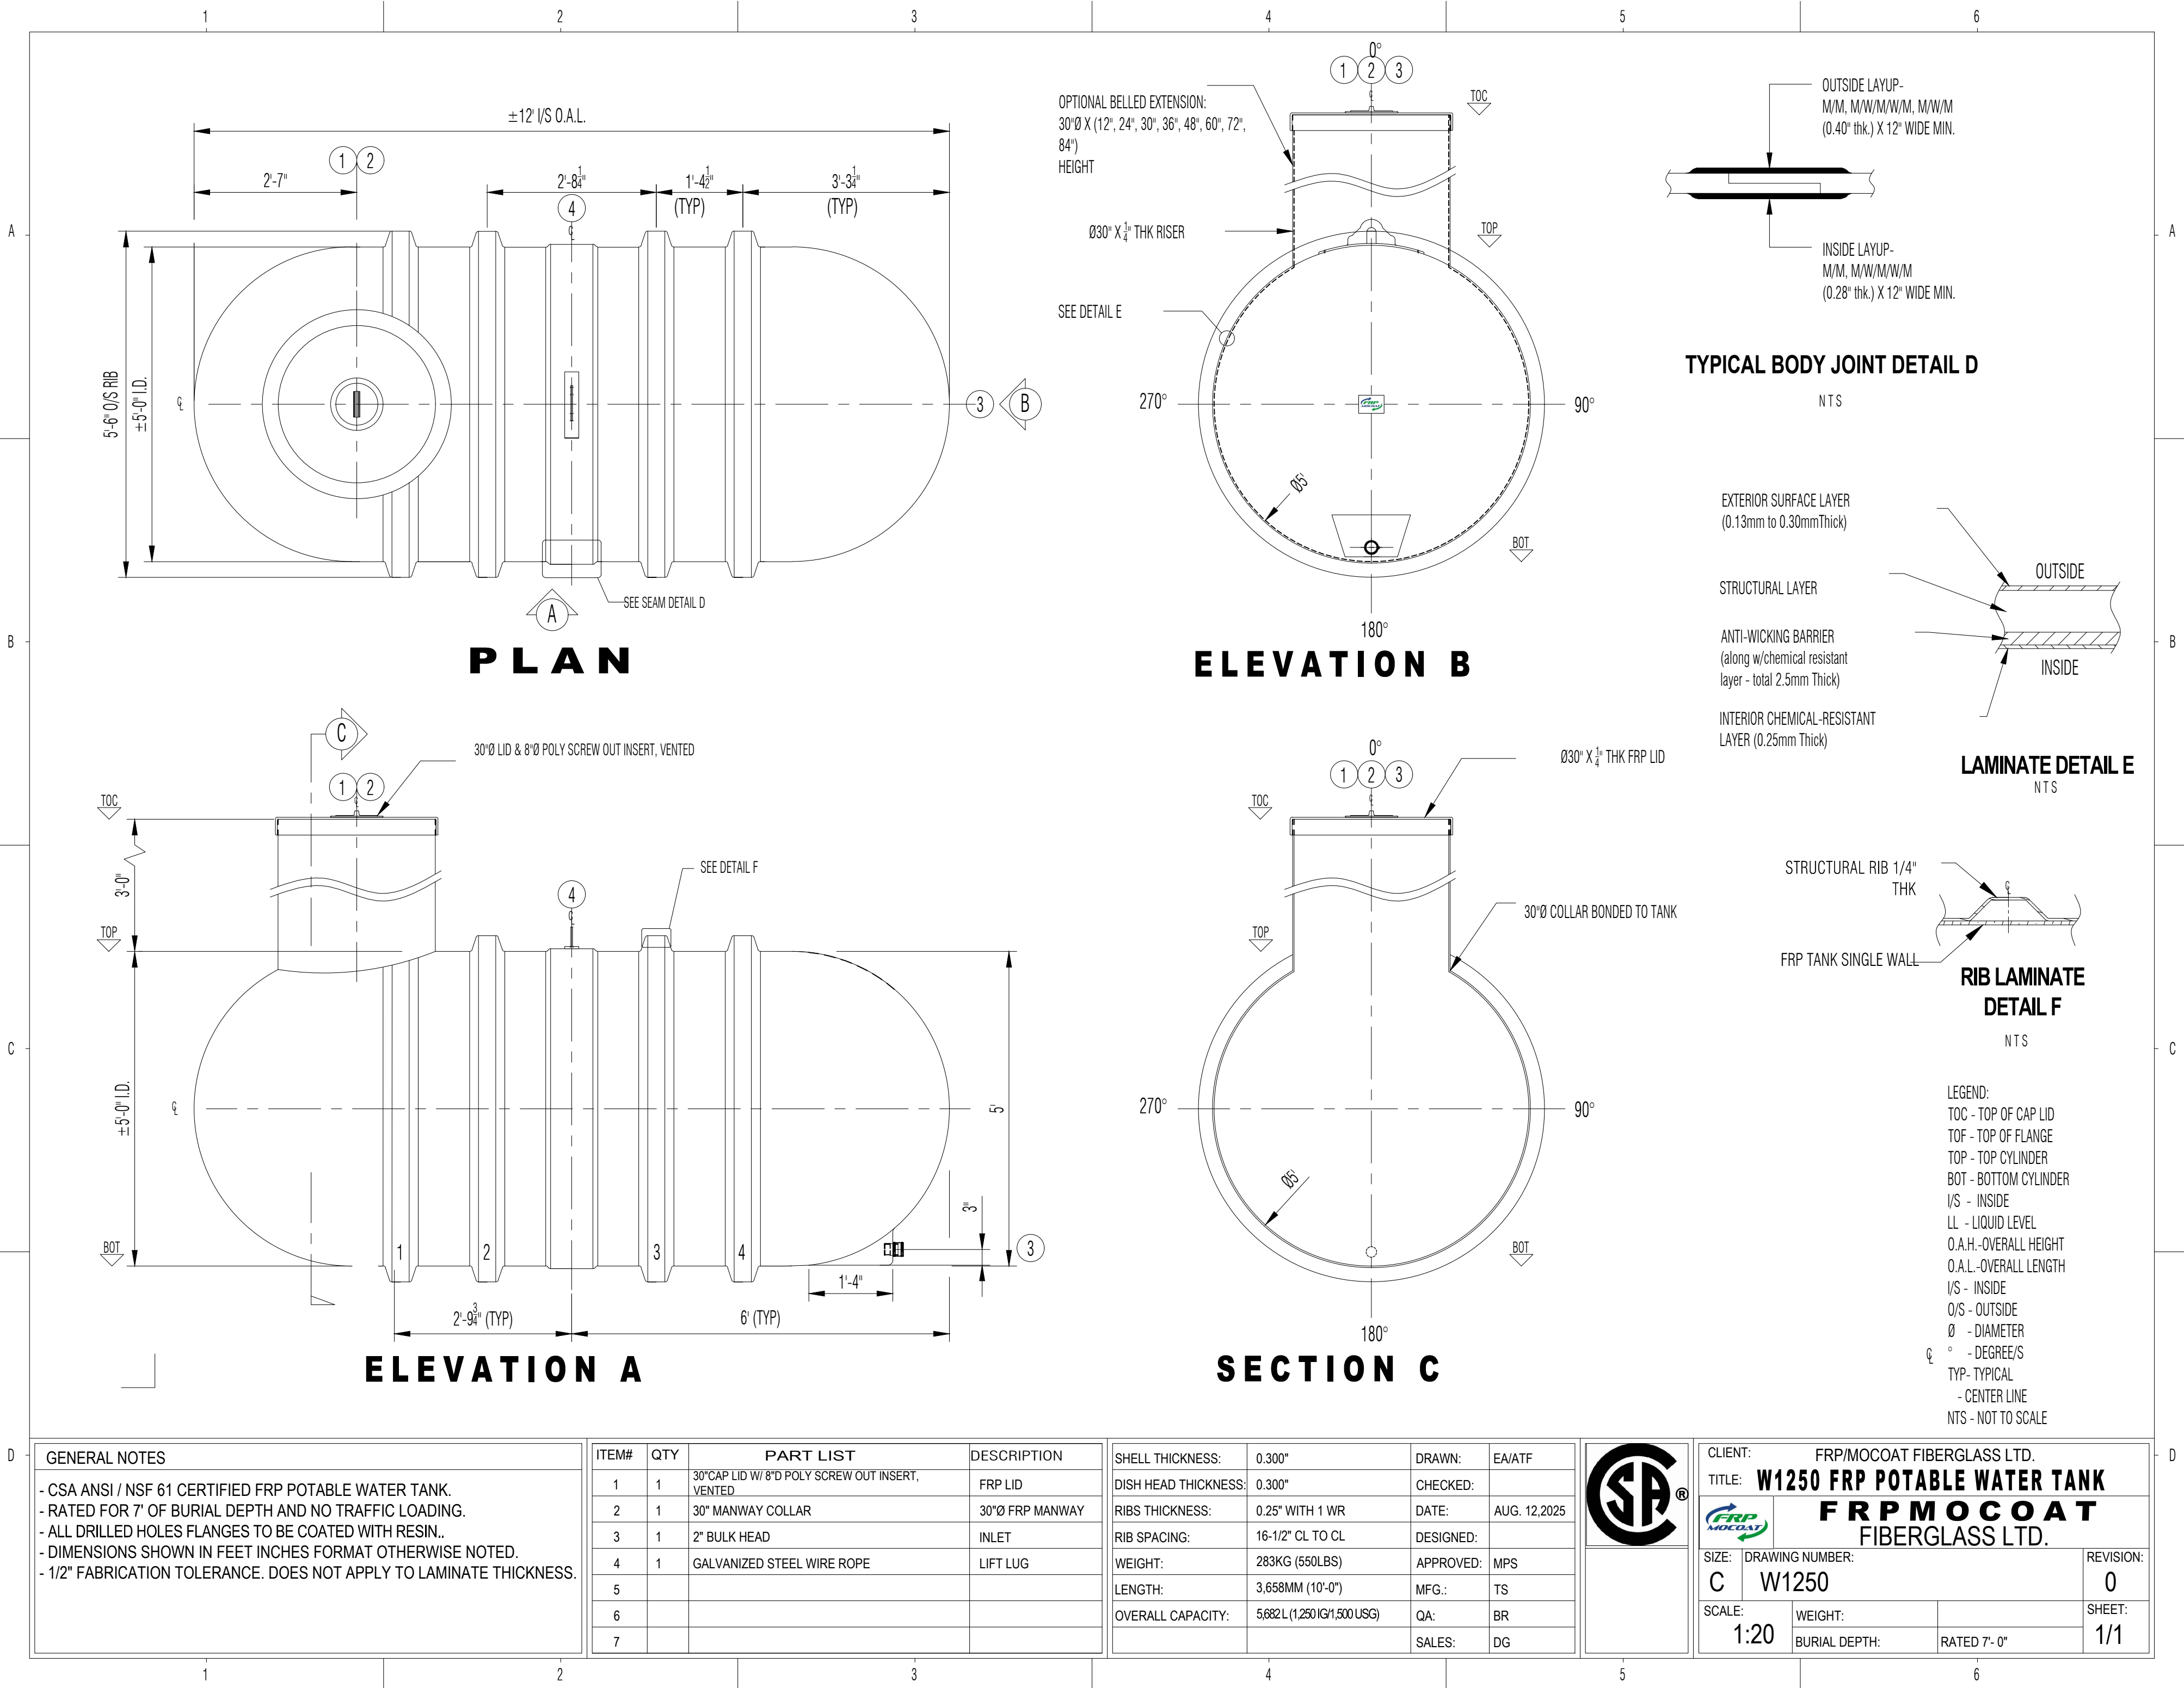

GENERAL NOTES	
- CSA ANSI / NSF 61 CERTIFIED FRP POTABLE WATER TANK.	
- RATED FOR 7' OF BURIAL DEPTH AND NO TRAFFIC LOADING.	
- ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN..	
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.	
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.	

ITEM#	QTY	PART LIST	DESCRIPTION
1	1	30"CAP LID W/ 8"D POLY SCREW OUT INSERT, VENTED	FRP LID
2	1	30" MANWAY COLLAR	30"Ø FRP MANWAY
3	1	2" BULK HEAD	INLET
4	1	GALVANIZED STEEL WIRE ROPE	LIFT LUG
5			
6			
7			

SHELL THICKNESS:	0.300"	DRAWN:	EA/ATF
DISH HEAD THICKNESS:	0.300"	CHECKED:	
RIBS THICKNESS:	0.25" WITH 1 WR	DATE:	AUG. 12,2025
RIB SPACING:	16-1/2" CL TO CL	DESIGNED:	
WEIGHT:	283KG (550LBS)	APPROVED:	MPS
LENGTH:	3.658MM (10'-0")	MFG.:	TS
OVERALL CAPACITY:	5,682L (1,250 IG/1,500 USG)	QA:	BR
		SALES:	DG

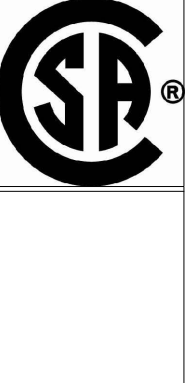

CLIENT: FRP/MOCOAT FIBERGLASS LTD.	
TITLE: W1250 FRP POTABLE WATER TANK	
FRP MOCOAT FIBERGLASS LTD.	
SIZE: C	DRAWING NUMBER: W1250
SCALE: 1:20	REVISION: 0
WEIGHT:	SHEET: 1/1
BURIAL DEPTH:	RATED 7'- 0"



W1250 FRP POTABLE WATER TANK

