


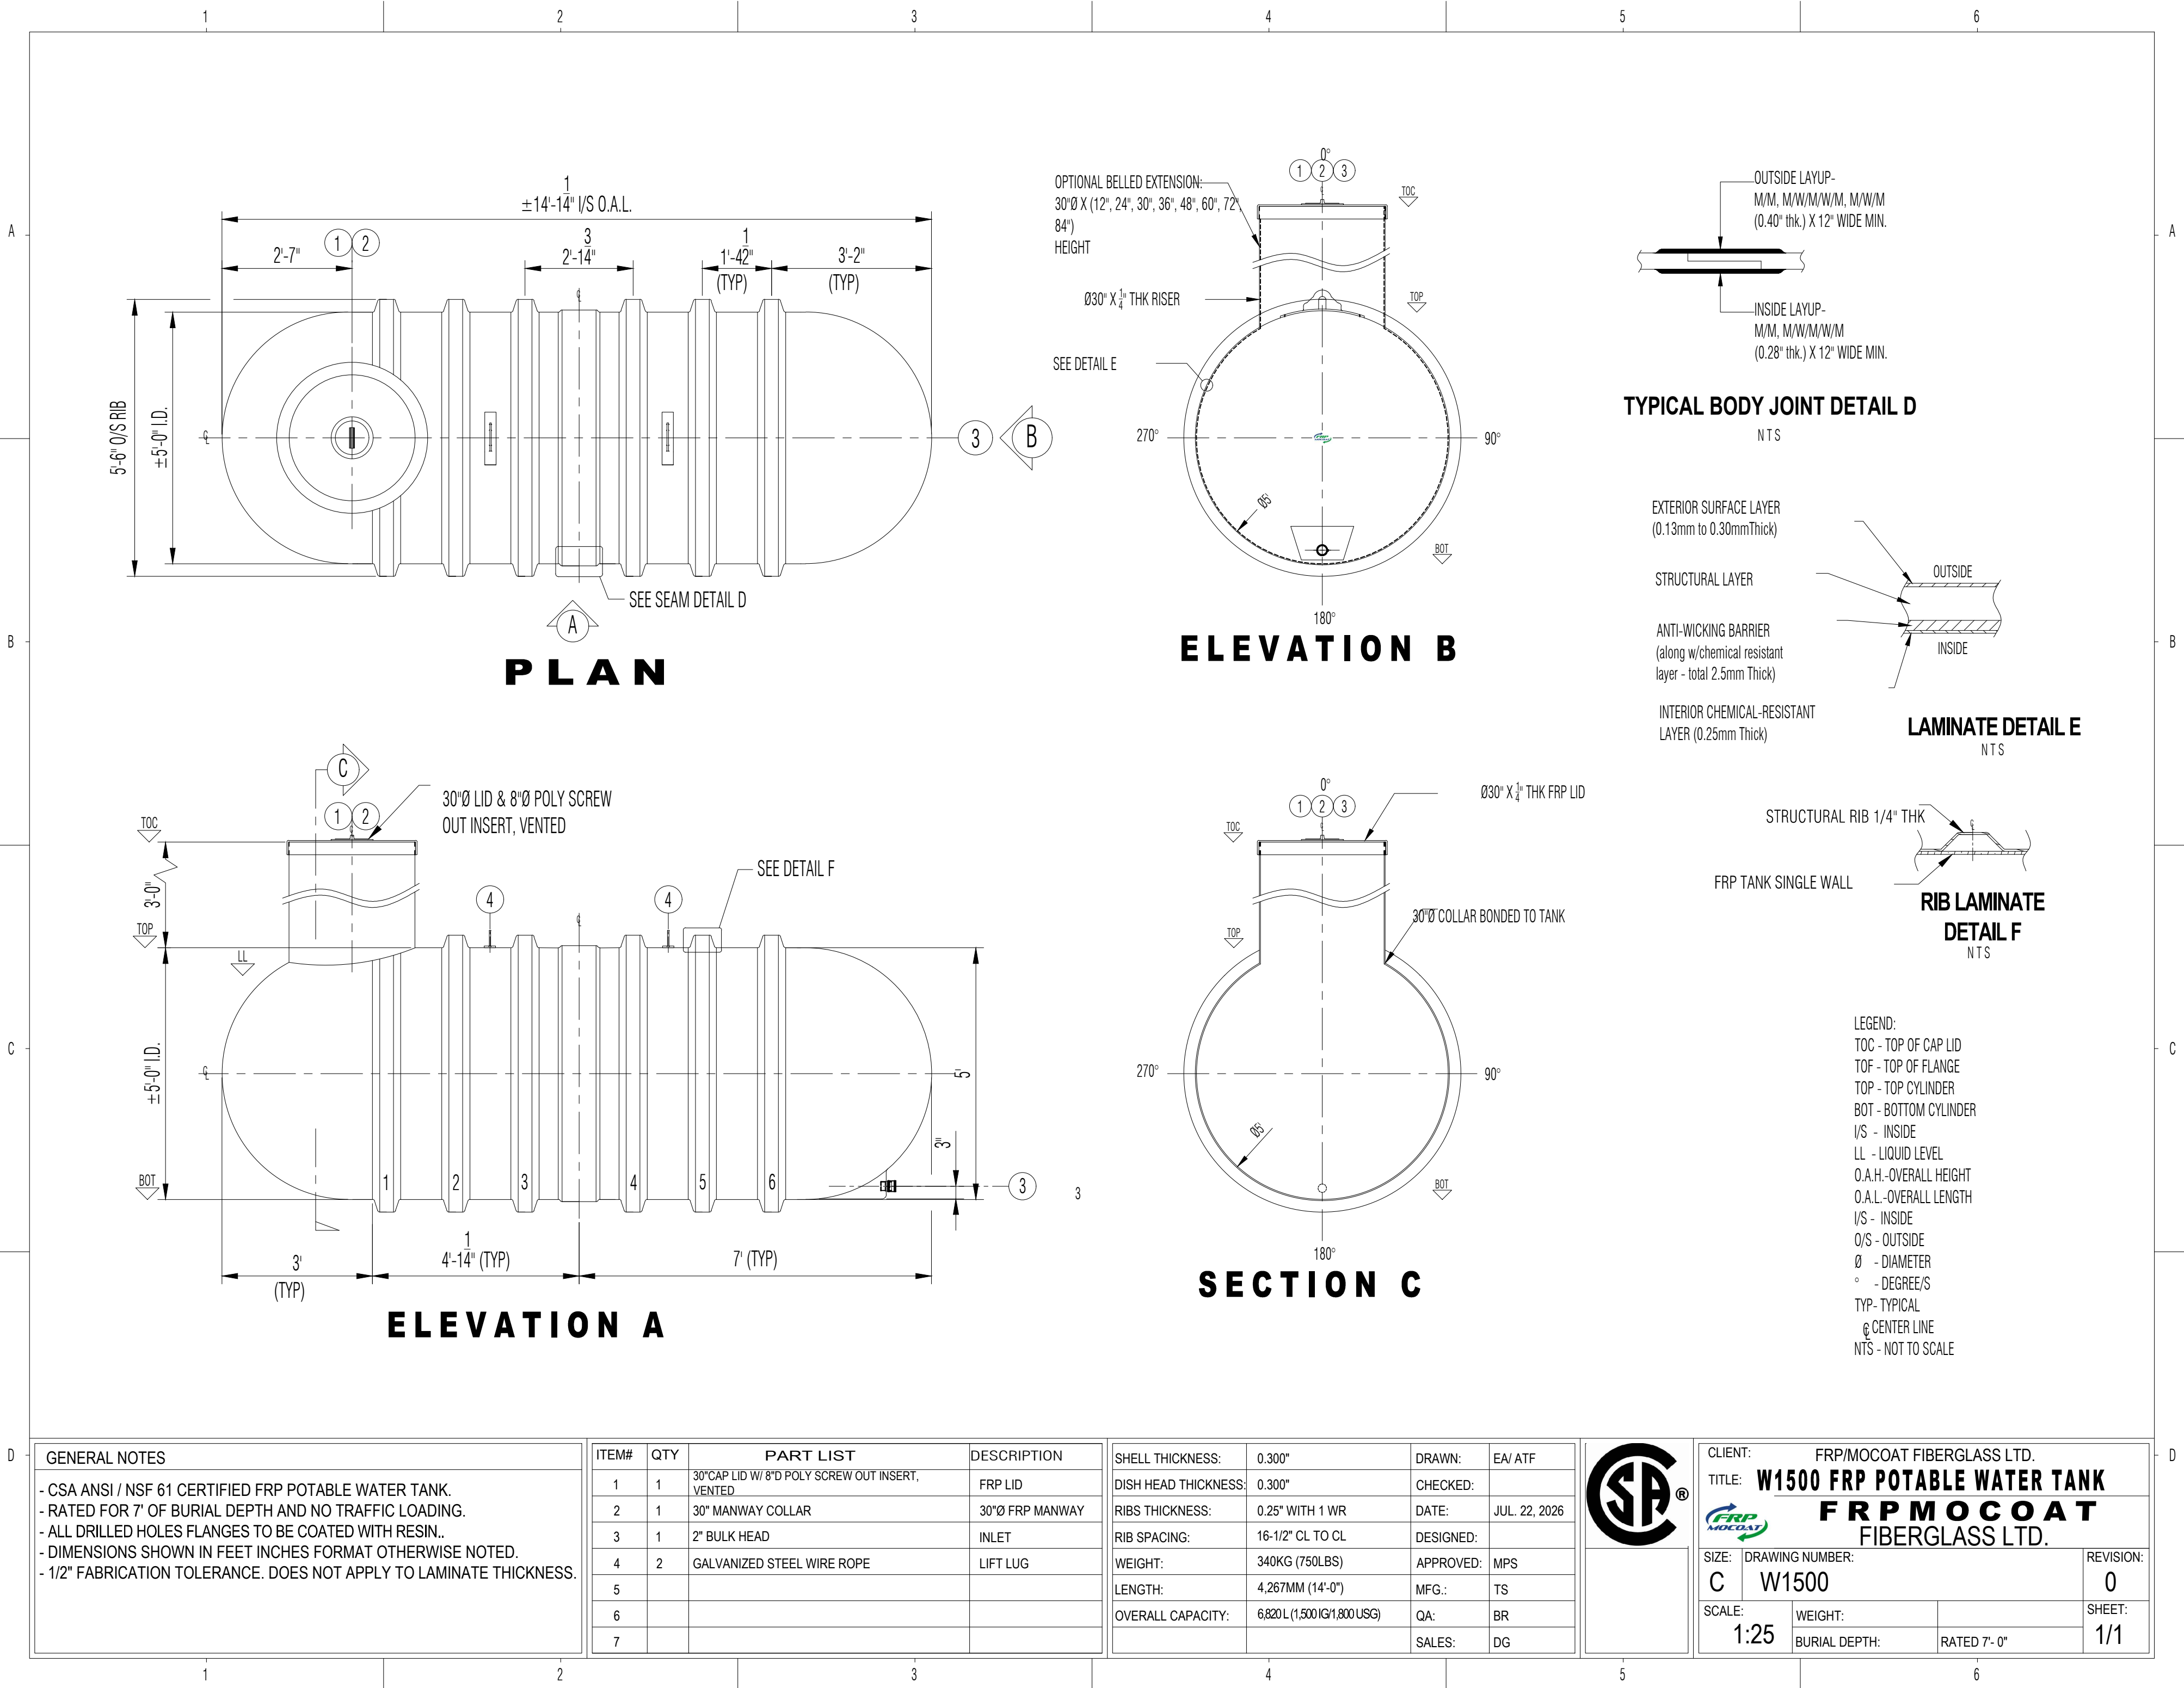

GENERAL NOTES

- CSA ANSI / NSF 61 CERTIFIED FRP POTABLE WATER TANK.
- RATED FOR 7' OF BURIAL DEPTH AND NO TRAFFIC LOADING.
- ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN..
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.

ITEM#	QTY	PART LIST	DESCRIPTION
1	1	30"CAP LID W/ 8"D POLY SCREW OUT INSERT, VENTED	FRP LID
2	1	30" MANWAY COLLAR	30"Ø FRP MANWAY
3	1	2" BULK HEAD	INLET
4	2	GALVANIZED STEEL WIRE ROPE	LIFT LUG
5			
6			
7			

SHELL THICKNESS:	0.300"	DRAWN:	EA/ ATF
DISH HEAD THICKNESS:	0.300"	CHECKED:	
RIBS THICKNESS:	0.25" WITH 1 WR	DATE:	JUL. 22, 2026
RIB SPACING:	16-1/2" CL TO CL	DESIGNED:	
WEIGHT:	340KG (750LBS)	APPROVED:	MPS
LENGTH:	4,267MM (14'-0")	MFG.:	TS
OVERALL CAPACITY:	6,820 L (1,500 IG/1,800 USG)	QA:	BR
		SALES:	DG



CLIENT:	FRP/MOCOAT FIBERGLASS LTD.		
TITLE:	W1500 FRP POTABLE WATER TANK		
	FRP MOCOAT		
	FIBERGLASS LTD.		
SIZE:	DRAWING NUMBER:	REVISION:	
C	W1500	0	
SCALE:	WEIGHT:	SHEET:	
1:25	BURIAL DEPTH:	1/1	
	RATED 7'- 0"		



W1500 FRP POTABLE WATER TANK

