




GENERAL NOTES - CSA ANSI / NSF 61 CERTIFIED FRP POTABLE WATER TANK. - RATED FOR 7' OF BURIAL DEPTH AND NO TRAFFIC LOADING. - ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN.. - DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED. - 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.	ITEM#	QTY	PART LIST	DESCRIPTION	SHELL THICKNESS:	0.300"	DRAWN:	EA/ ATF	CSF	CLIENT: FRP/MOCOAT FIBERGLASS LTD.			
	1	1	30"CAP LID W/ 8"D POLY SCREW OUT INSERT, VENTED	FRP LID	DISH HEAD THICKNESS:	0.300"	CHECKED:			TITLE: W1750 FRP POTABLE WATER TANK			
	2	1	30" MANWAY COLLAR	30"Ø FRP MANWAY	RIBS THICKNESS:	0.25" WITH 1 WR	DATE:	JUL. 12, 2026		FRP MOCOAT			
	3	1	2" BULK HEAD	INLET	RIB SPACING:	16-1/2" CL TO CL	DESIGNED:			FIBERGLASS LTD.			
	4	2	GALVANIZED STEEL WIRE ROPE	LIFT LUG	WEIGHT:	397KG (875LBS)	APPROVED:	MPS		SIZE: C	DRAWING NUMBER: W1750		REVISION: 0
	5				LENGTH:	4,877MM (16'-0")	MFG.:	TS		SCALE: 1:25	WEIGHT:		SHEET: 1/1
	6				OVERALL CAPACITY:	7,955L (1,750 IG/2,100 USG)	QA:	BR		BURIAL DEPTH:	RATED 7'- 0"		
	7						SALES:	DG					



W1750 FRP POTABLE WATER TANK

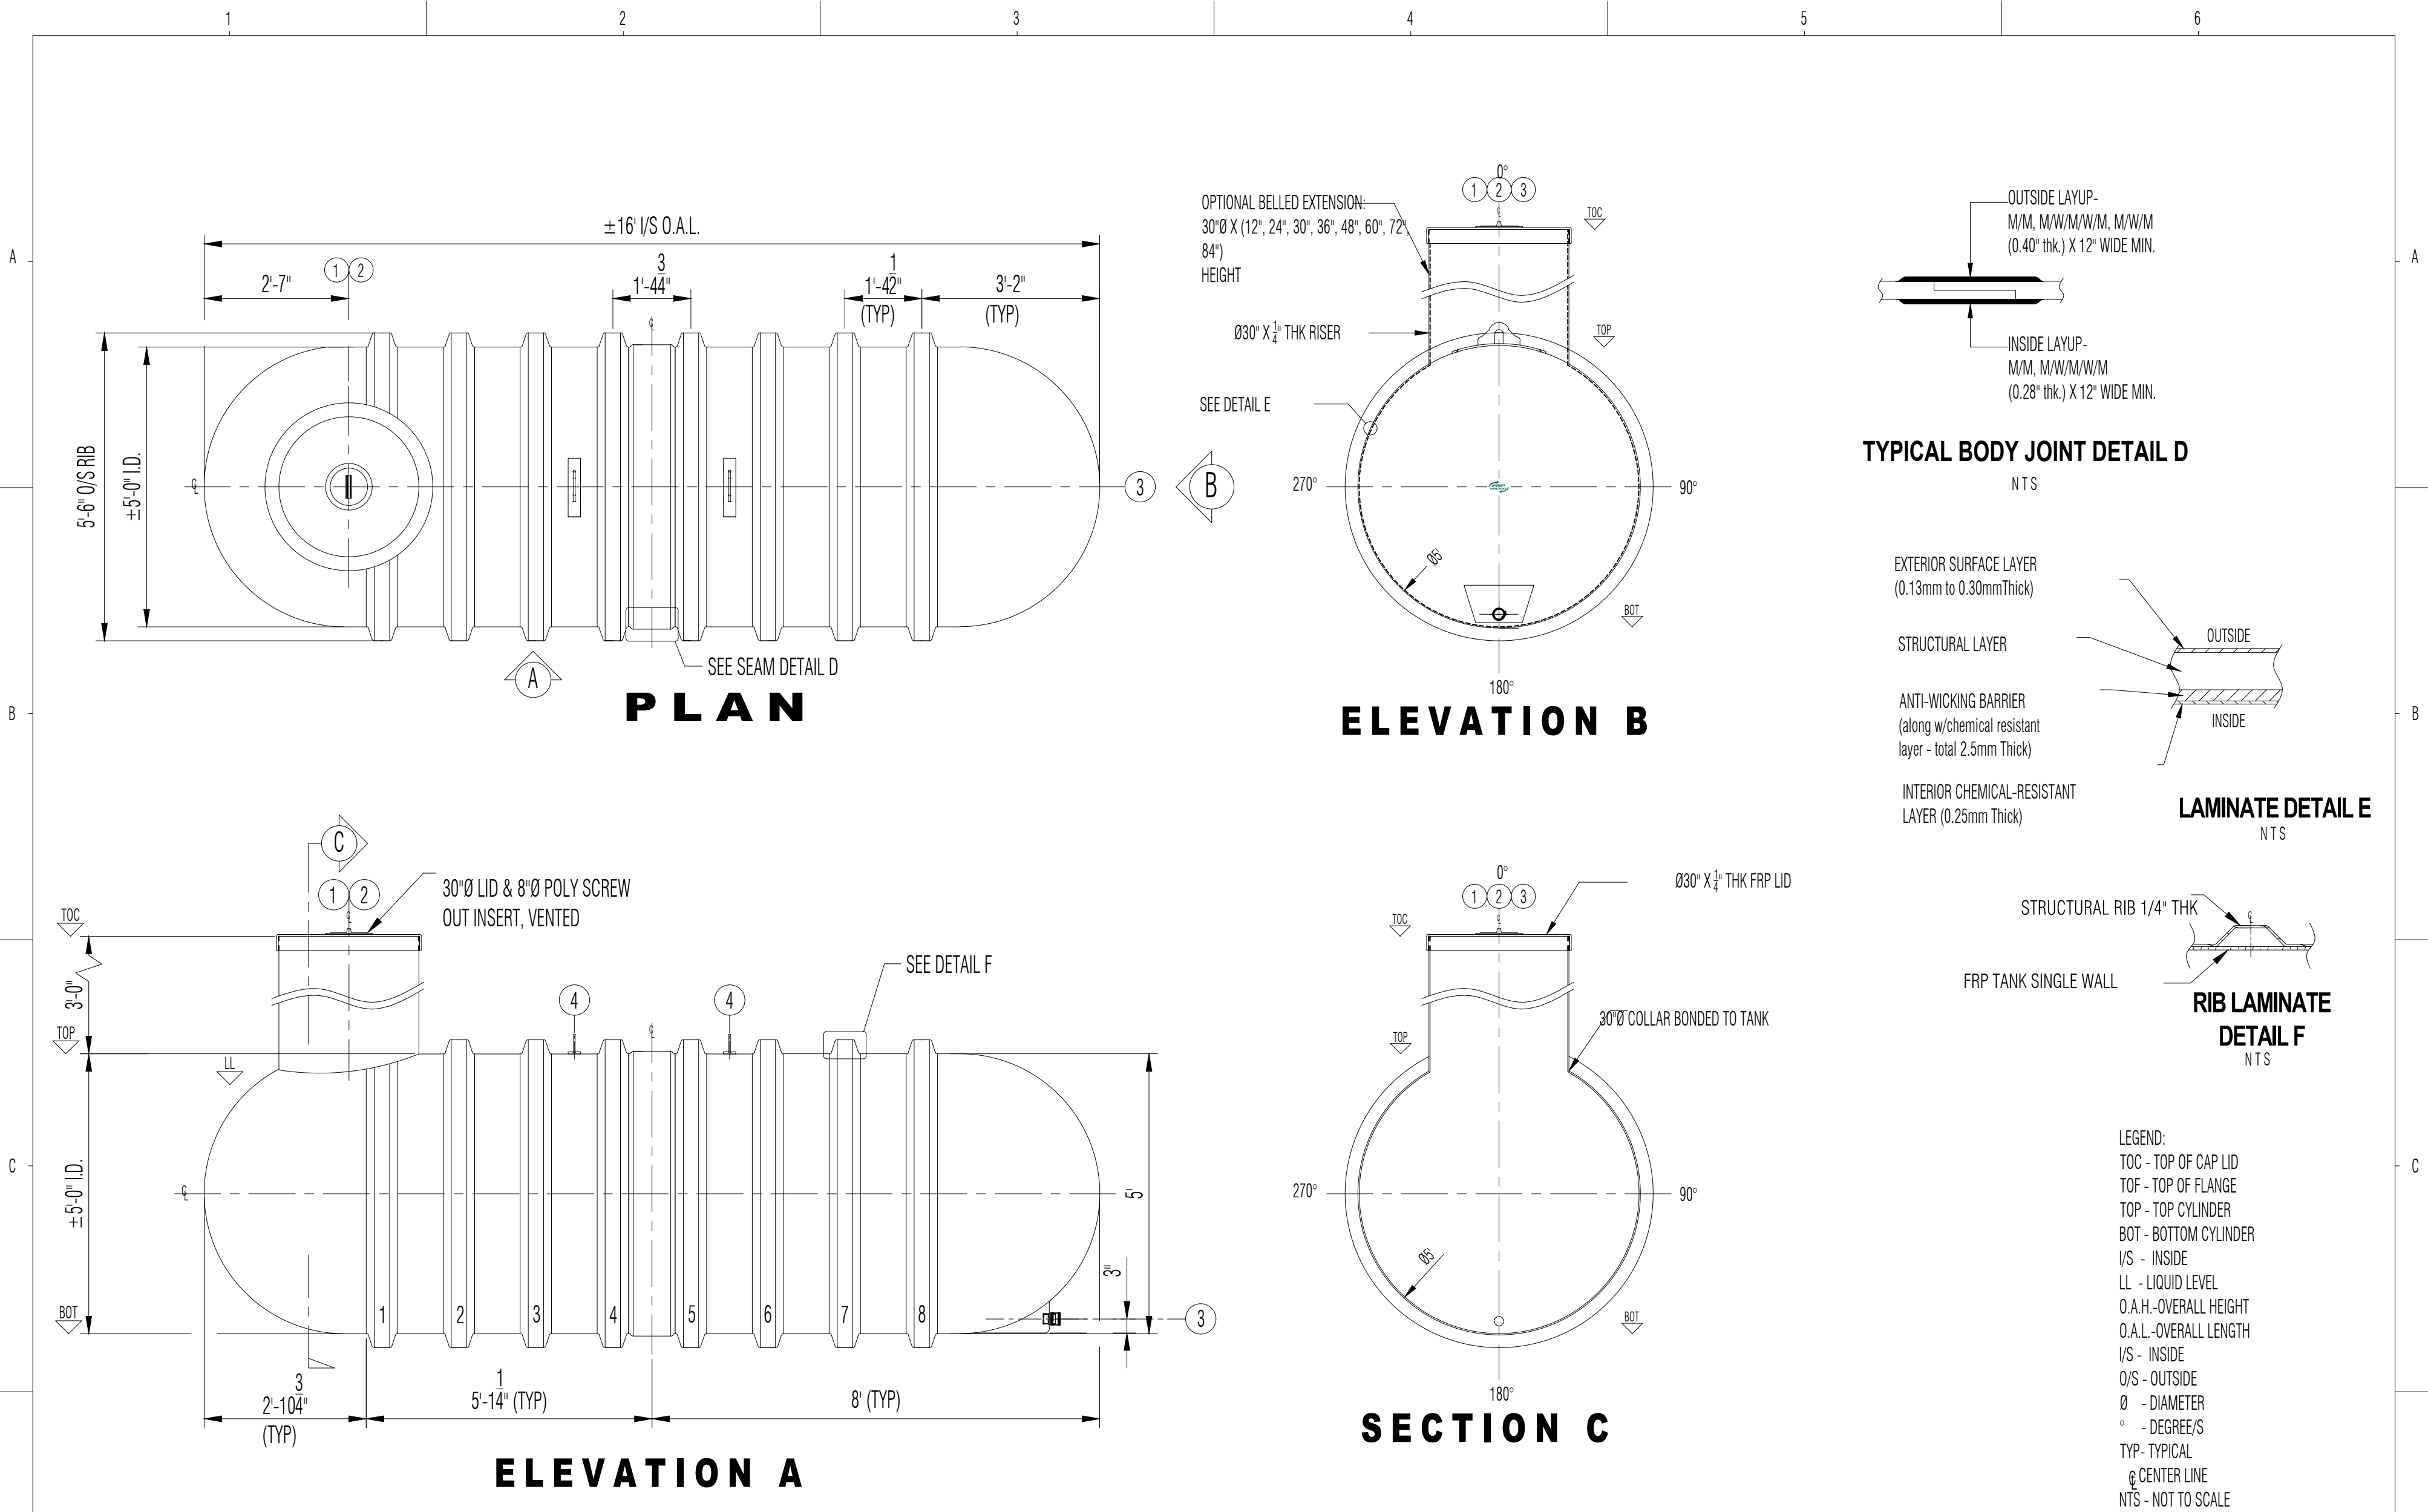