




GENERAL NOTES:

- CSA B66 CERTIFIED FRP SEPTIC TANK.
- RATED FOR 7' OF BURIAL DEPTH AND NO TRAFFIC LOADING.
- BAFFLE WALL IS INSTALLED. VOLUMES ARE APPROXIMATE.
- ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN.
- SAFETY GRATE CAN WITHSTAND 91 KG. OF DEAD LOAD.
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.

ITEM#	QTY	PART LIST	DESCRIPTION	SHELL THICKNESS:	0.300"	DRAWN:	ATF
1	2	30" CAP LID	FPR LID	DISH HEAD THICKNESS:	0.300"	CHECKED:	
2	2	30"Ø MANWAY COLLAR	30"Ø FRP COLLAR	RIBS THICKNESS:	0.25" WITH 1 WR	DATE:	JAN 24, 2025
3	1	4"ØX12"L PVC DWV STUB PIPE WITH INTERNAL TEEWYE AND FERNCO	INLET	WEIGHT:	522KG (1,150 LBS)	DESIGNED:	
4	2	FRP FULL BAFFLE WALL W/ REINFORCEMENT	BAFFLE WALL	LENGTH:	4,267MM (14'-0")	APPROVED:	MPS
5	1	POLYETHYLENE SAFETY GRATE C/W HARDWARE	SAFETY GRATE	FIRST CHAMBER:	3,392L (746IG/895 USG)	MFG:	DS
6	2	MILD STEEL	LIFT LUGS	SECOND CHAMBER:	1,700 L (374IG/449 USG)	QA:	GA
7				EFFLUENT CHAMBER:	963 L (212IG/254 USG)	SALES:	TA

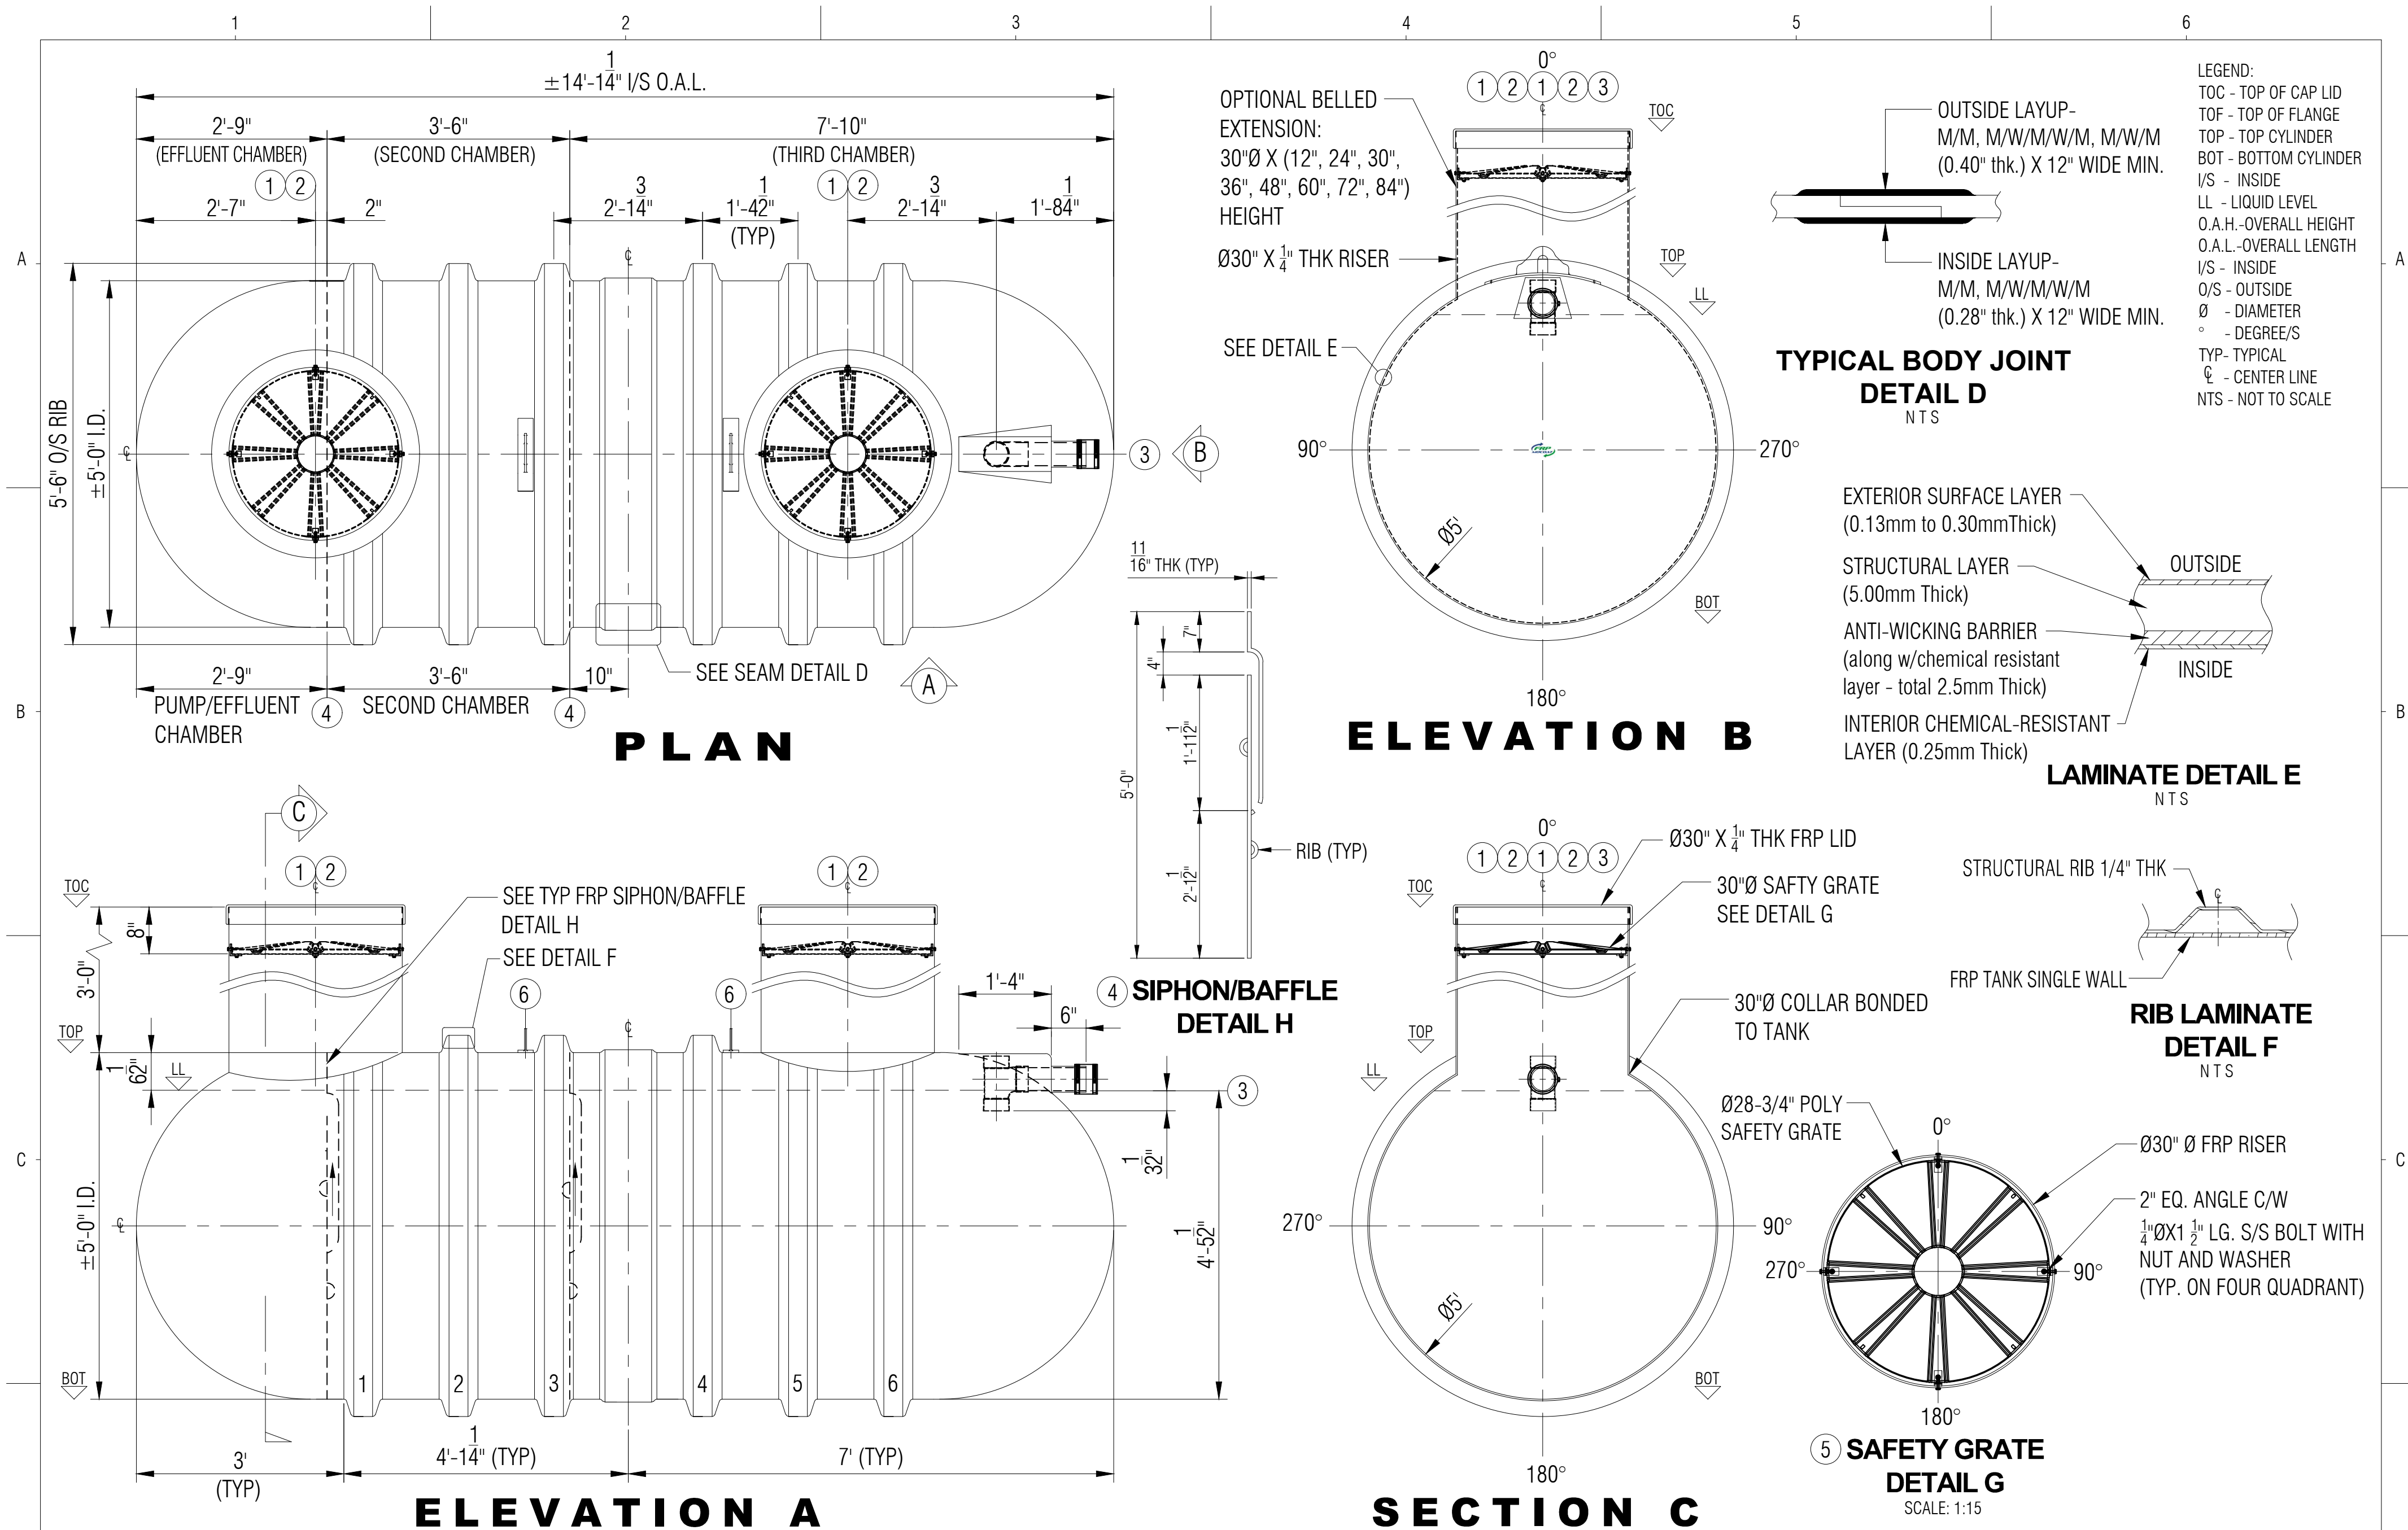

CLIENT: FRP/MOCOAT FIBERGLASS LTD.

TITLE: **3CP0-1200 FRP PUMPOUT TANK**

FRP MOCOAT
FIBERGLASS LTD.

SIZE	DRAWING NUMBER:	REVISION
C	3CP0-1200	0
SCALE	WEIGHT:	SHEET
1:20	BURIAL DEPTH:	1/1
	RATED 7'-0"	



3CPO-1200 FRP PUMPOUT TANK

