




GENERAL NOTES:

- CSA B66 CERTIFIED FRP SEPTIC TANK.
- RATED FOR 12' OF BURIAL DEPTH AND NO TRAFFIC LOADING.
- BAFFLE WALL IS INSTALLED. VOLUMES ARE APPROXIMATE.
- ALL DRILLED HOLES FLANGES TO BE COATED WITH RESIN.
- SAFETY GRATE CAN WITHSTAND 91 KG. OF DEAD LOAD.
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.

ITEM#	QTY	PART LIST	DESCRIPTION	SHELL THICKNESS:	0.346"	DRAWN:	ATF
1	1	30" CAP LID	FPR LID	DOME HEAD THICKNESS:	0.351"	CHECKED:	
2	1	30"Ø MANWAY COLLAR	30"Ø FRP MANWAY	RIBS THICKNESS:	0.30" WITH 1 WR	DATE:	DEC 5, 2024
3	1	4"ØX12"L PVC DWV STUB PIPE WITH INTERNAL TEEWYE AND FERNCO	INLET	WEIGHT:	453KG (1,000LBS)	DESIGNED:	
4	1	FRP FULL BAFFLE WALL W/ REINFORCEMENT	BAFFLE WALL	LENGTH:	4,267MM (14'-0")	APPROVED:	MPS
5	2	MILD STEEL LUGS	LIFT LUGS	SEPTIC CHAMBER:	5,092L (1,120 IG/1,344 USG)	MFG:	DS
6	1	POLYETHYLENE SAFETY GRATE C/W HARDWARE	SAFETY GRATE	EFFLUENT CHAMBER:	963 L (212 IG/254 USG)	QA:	GA
7				OVERALL CAPACITY:	6,819 L (1,500 IG/1,800 USG)	SALES:	TA

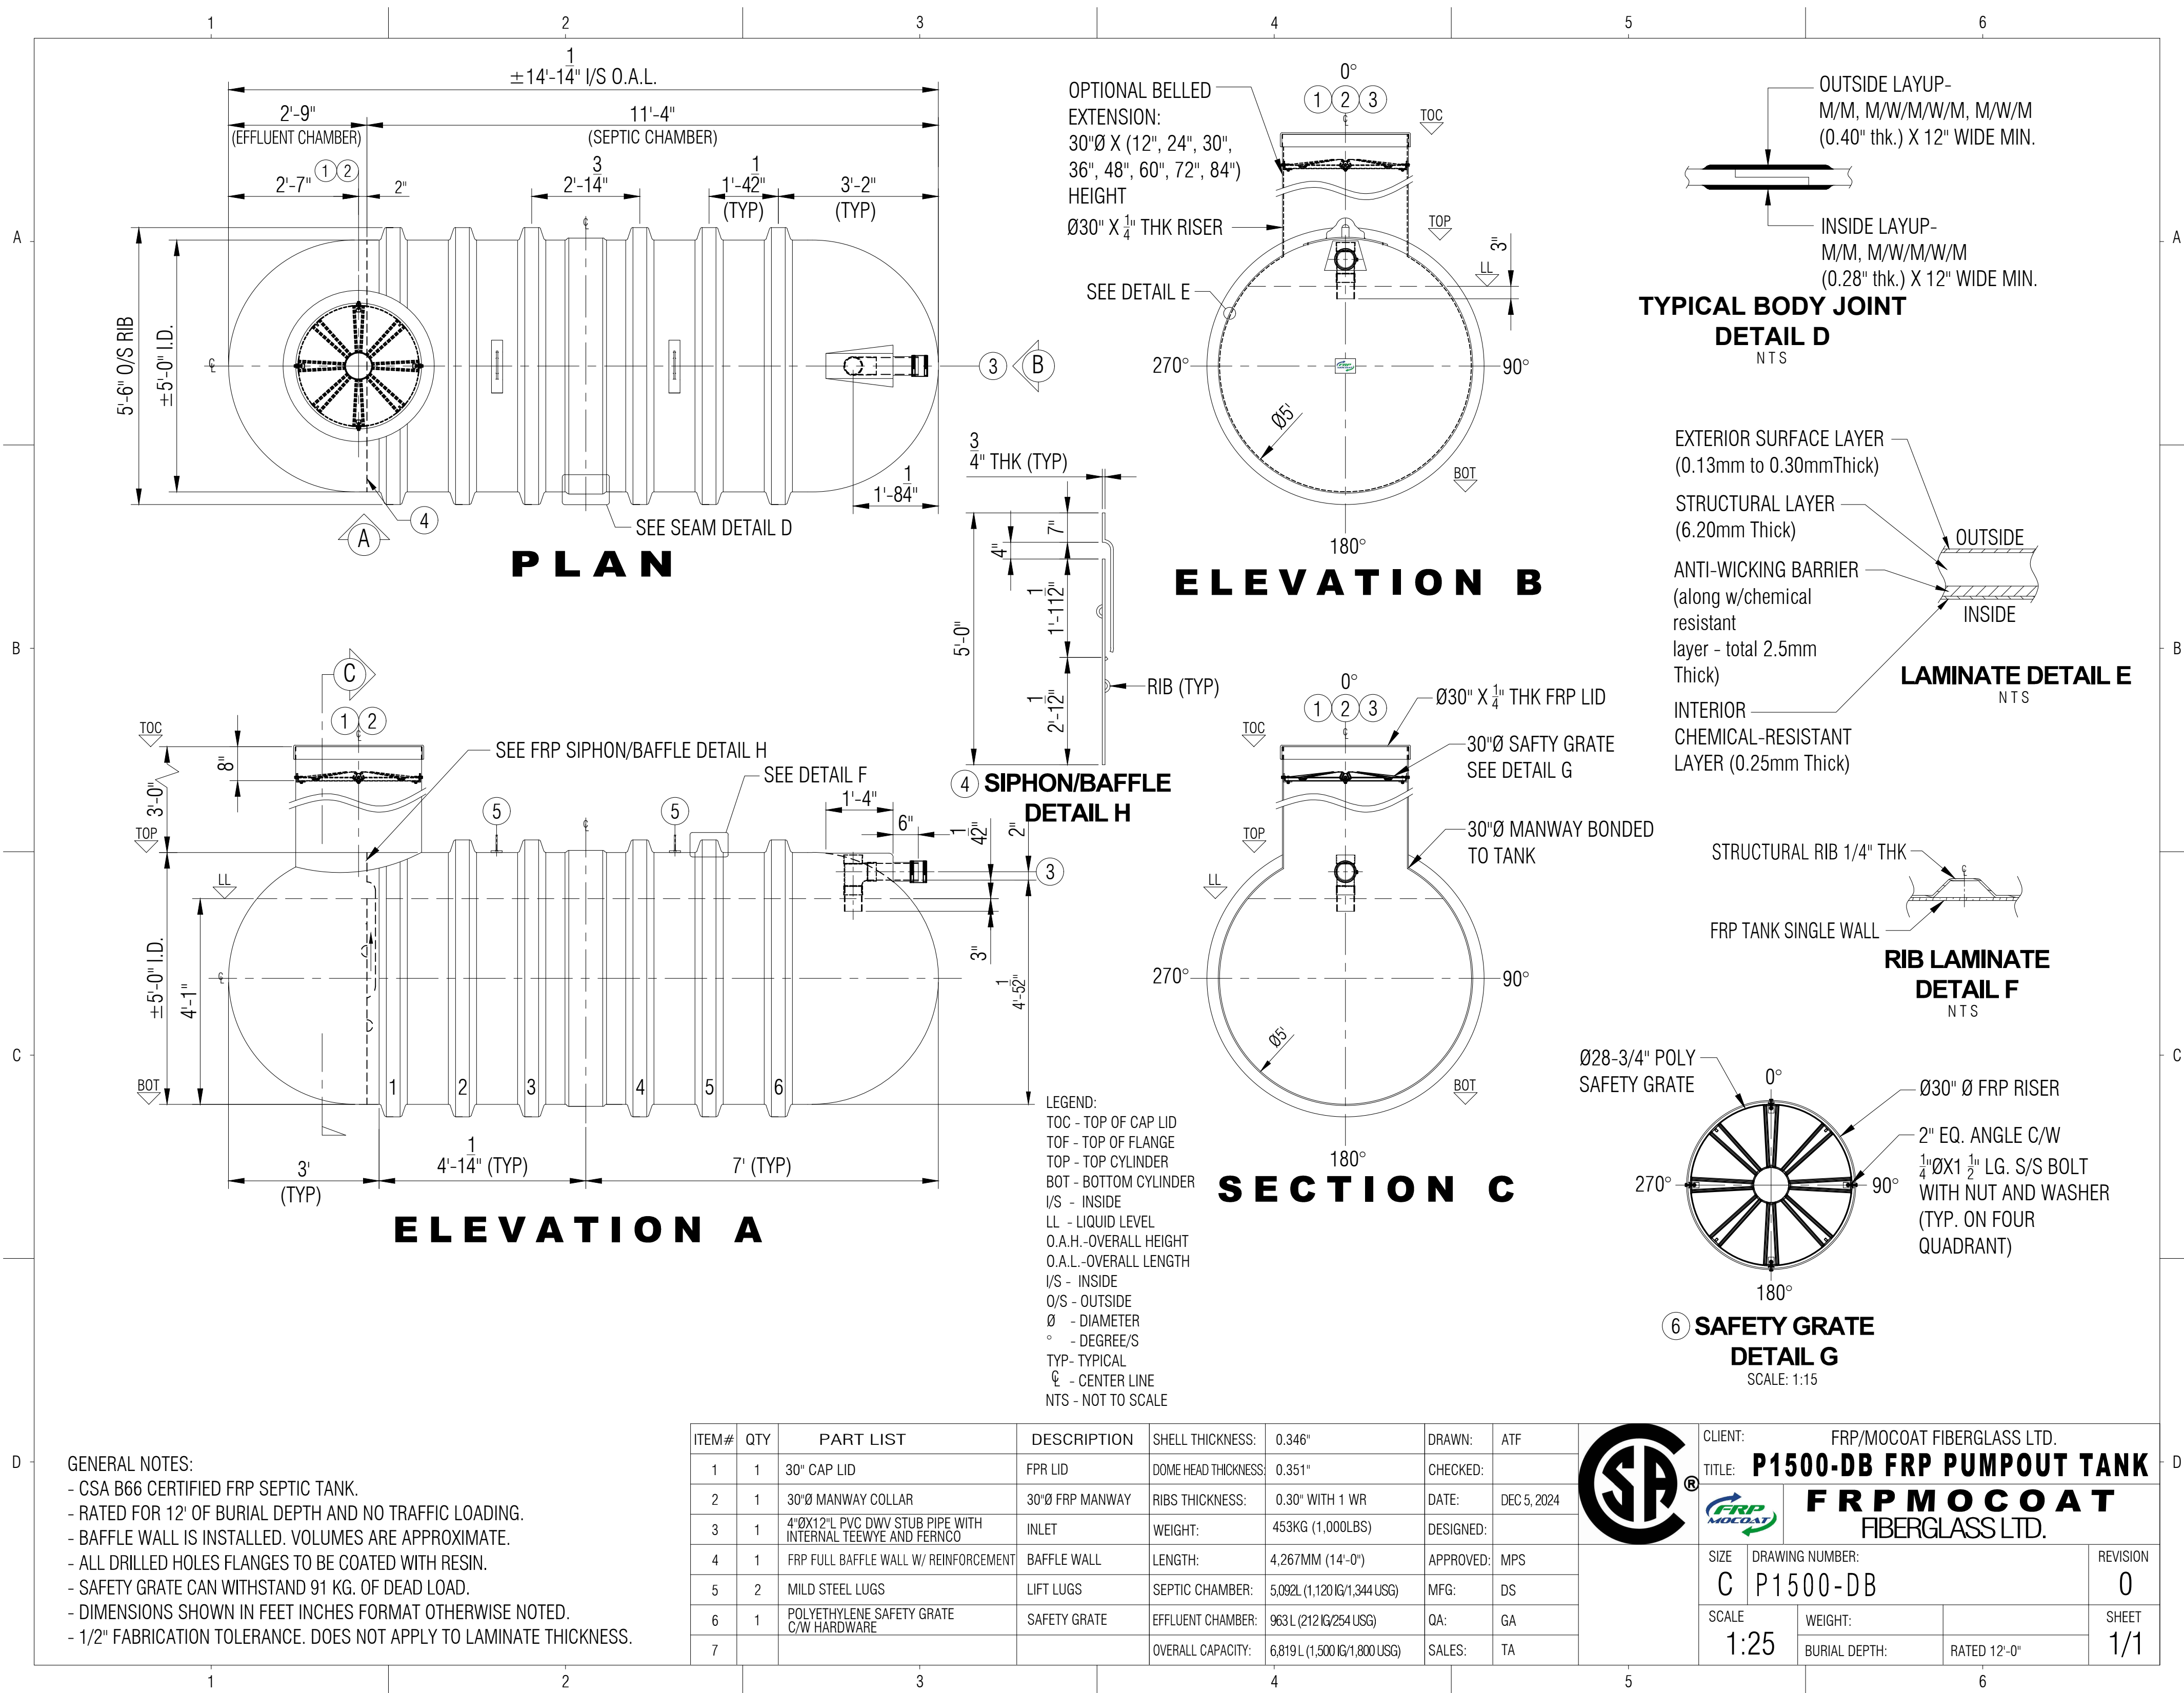

CLIENT: FRP/MOCOAT FIBERGLASS LTD.			
TITLE: P1500-DB FRP PUMPOUT TANK			
FRP MOCOAT FIBERGLASS LTD.			
SIZE: C	DRAWING NUMBER: P1500-DB		REVISION: 0
SCALE: 1:25	WEIGHT:		SHEET: 1/1
	BURIAL DEPTH:	RATED 12'-0"	



H1500-DB FRP SEWAGE HOLDING TANK

